


ALL ELECTRICAL WORK MUST BE ACCORDANCE WITH THE 2017 NATIONAL ELECTRICAL CODE (NEC) AND THE NEW MEXICO CODE (NMEC)

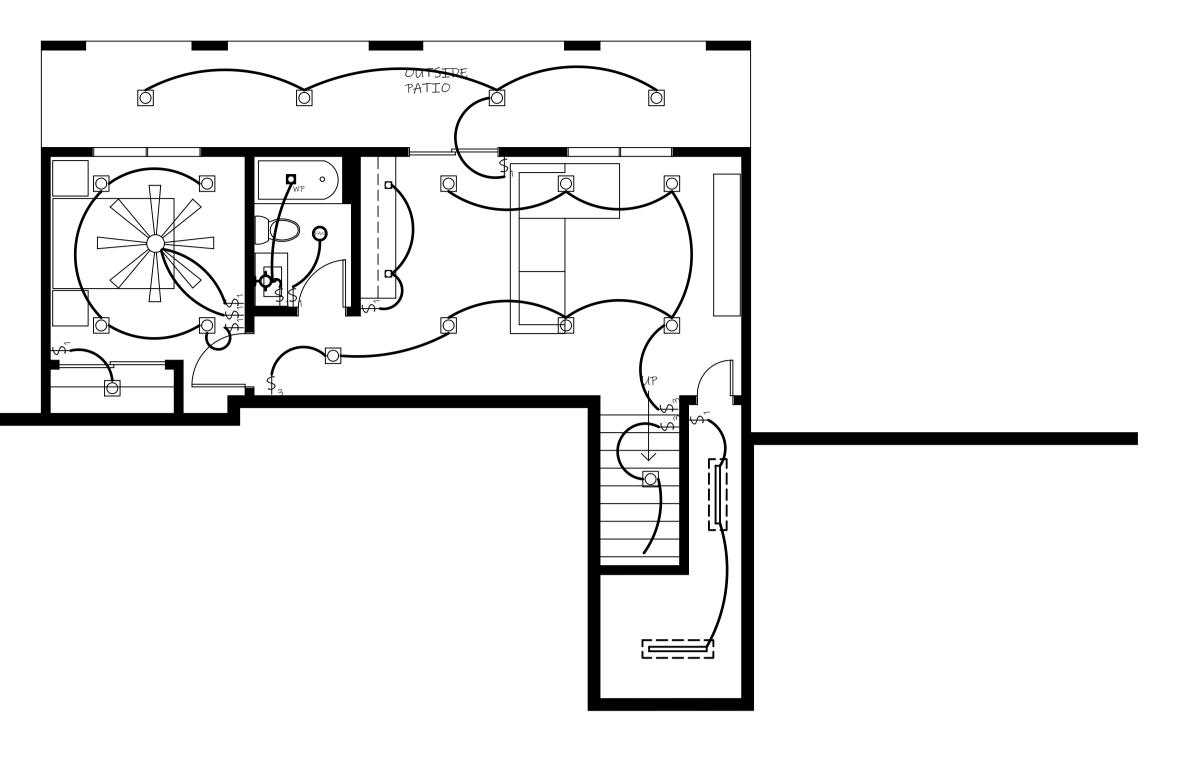

ALL ELECTRICAL WIRE TO BE MINIMUM NM 12 GAUGE PER CODE OUTDOOR LIGHTING TO COMPLY WITH NM NIGHT SKY PROTECTION ACT 1/3 OF OUTDOOR LIGHTING TO BE TIMED, OR CONTAIN SENSORS. A LISTED NON FLEXIBLE 1-1/4" ELECTRICAL RACEWAY SHALL BE PROVIDED TO ROOF FOR FUTURE PHOTOVOLTAIC WIRING.

	CLTY OF ALBUQUERQUE
	PLANNING
These plans have been reviewed for code compliance and are:	
APPROVED	
The Approval of these plans shall not be construed to be a permit for any	
	LIGHTING LEAT Not this city.
П	NM 2015 TRPERMIT #: BP-2022-01872
	6" FULL RECE DATE LEOSTADZE (ALL'K - NT) SEAL TO CEILING. ENTR: / ST F2 RATID Applied copy of here play the locate control of the formal
	MINIRECESSED LED _ POPPERTING STAR AND SEAL TO CEILING. ENERGY STAR RATED
	EXTERIOR LED MINI SOFFIT LIGHTING. CAULK AND SEAL TO CEILING. ENERGY STAR RATED
	WALL SCONCE OR LIGHT BAR ENERGY STAR RATED. ENERGY STAR BULB
	UNDER CABINET LIGHT. ENERGY STAR RATED. ENERGY STAR BULB
	4FT LED WRAPAROUND LIGHT FIXTURE, FLUSH MOUNT, ENERGY STAR RATED,
600	PENDENT LIGHTING, ENERGY STAR RATED W/ENERGY STAR RATED BULBS,
\bigcirc	CHANDELIER.
EN	CEILING FAN W/REVERSE SWITCH, SEPARATE LIGHT SWITCH, ENERGY STAR RATED,
	LED ROPE LIGHT FOR SOFFITS
NT WP	WATER PROOF LED RECESSED LIGHT, CAULK AND SEALL TO CEILING, ENERGY STAR RATED,
\$1	ONE WAY OPERATED SWITCH
\$ ₃	TWO WAY OPERATED SWITCH
\$4	THREE WAY OPERATED SWITCH
\$ ₁₇	TIMER OPERATED SWITCH
\$ _{IP}	MOTION SENSOR SWITCH
-	

BASEMENT LIGHTING

SCALE; 3/16" = 1'-0"

NĦ OWER TERRACE CIRCLE UERQUE, NM. 87111 DESIGN 000 \sim 4520 LOW: Albuquer 505-362-2 \mathcal{Q} \sim $\overline{}$ \sim 20 NG 1 5 GHF ____ APRI H Ð -MN Ĥ ME Y Ø \leq Y \mathcal{O} SHEET OF 10 SHEETS